

Greenville Fire Department

ANNUAL REPORT

2015





GREENVILLE FIRE DEPARTMENT

125 Main Street
Greenville, PA 16125

P: 724-588-4190 F: 724-588-5055



Brian D. Mazzanti
Director of Public Safety

January 13, 2016

2015 Annual Fire Department Report Summary to Council

FIRE OPERATIONS:

Total Fire Department Responses Total = 880

Fires - 663

Building Fire - 36
Fires in Structure Other Than in a Building - 3
Cooking Fire, Confined to Container - 6
Cooking Equipment Fire - 1
Chimney or Flue Fire, Confined to Chimney - 1
Trash or Rubbish Fire, Contained - 1
Mobile Property (Vehicle) Fire, Other - 1
Passenger Vehicle Fire - 3
Natural Vegetation Fire, Other - 1
Natural Vegetation, Mulch (Landscaping) - 3
Brush or Brush-And-Grass Mixture Fire - 3
Outside Rubbish, Trash or Waste Fire - 4
Dumpster or Other Outside Trash Receptacle - 1
Outside Equipment Fire - 1
Cultivated Grain or Crop Fire - 1

Overpressure Rupture, Explosion, Overheat (No Fire) - 2

Explosion (No Fire), Other - 1
Excessive Heat, Scorch Burns - 1

Rescue and Emergency Medical Service Incidents - 524

Rescue, EMS Incident, Other - 1
Medical Assist, Assist EMS Crew - 31
Assist FD on Body Removal - 1
Emergency Medical Service, Other - 1
EMS Call, Excluding Vehicle Accident - 446

Monitored Medical Alarm; Accidental – 2
Motor Vehicle Accident With Injuries – 20
Motor Vehicle Accident With No Injuries – 15
Extrication of Victim(s) – 1
Extrication of Victim(s) From Vehicle – 5
Removal of Victim(s) From Stalled Elevator – 1

Hazardous Conditions (No Fire) – 53

Odor Investigation – 8
Utility Pole Leaning/Fallen – 2
Gasoline or Other Flammable Liquid Spill – 2
Gas Leak (Natural Gas or LPG) – 9
Oil or Other Combustible Liquid Spill – 4
Carbon Monoxide Symptoms, No CO – 1
Carbon Monoxide Investigation, No CO – 4
Carbon Monoxide Investigation, CO Present – 2
Electrical Wiring/Equipment Problem, Other – 5
Overheated Motor – 2
Power Line Down – 8
Power Line Arcing – 1
Arcing, Shorted Electrical Equipment – 1
Building or Structure Weakened or Collapsed – 3
Vehicle Accident, General Cleanup – 1

Service Call – 103

Lock-Out – 1
Water Problem, Other – 3
Water Evacuation – 1
Water Evacuation with Sump Pump – 10
Water or Steam Leak – 2
Water Leak – Building Service Line – 1
Water Leak – Municipal Main – 4
Water Leak – Sprinkler Piping – 5
Smoke or Odor Removal – 3
Animal Rescue – 2
Tree Fallen, Blocking Street – 2
Tree Fallen on Wires – 2
Tree Fallen – 3
Wire Fallen, Non-Electrical – 8
Assist Police or Other Governmental Agency – 4
Assist Police on a Meth Lab – 1
Replace Traffic Signal Bulb – 1
Traffic Signal Malfunction – 5
Public Service – 1
Public Service Fire Alarm System – 2
Assist Invalid – 3

Lift Fallen Person; No Injury – 18
Unauthorized Burning – 14
Complaint – Permitted Fire – 5
Cover Assignment, Standby, Move-Up – 2

Good Intent Call – 26

Dispatched & Cancelled En Route – 1
Wrong Location – 1
No Incident Found on Arrival at Dispatch – 1
Explosion Report; Unfounded – 1
Medical Call; Unfounded – 1
Vehicle Accident Reported; Unfounded – 2
Smoke Alarm Sounding; Unfounded – 1
Building Fire Reported; Unfounded – 5
Smoke Scare, Odor of Smoke – 13

False Alarm and False Call – 103

False Alarm or False Call, Other – 1
Central Station, Malicious False Alarm – 1
Smoke Detector Activation – 13
Heat Detector Activation Due to Malfunction – 2
Alarm System Sounded Due to Malfunction – 26
Unintentional Transmission of Alarm, Other – 4
Smoke Detector Activation, No Fire – 62
Duct Smoke Detector Activation, No Fire – 2
Flow Switch Activation, No Fire, Unintentional – 3
Alarm System Activation, No Fire – 5
Manual Pull Station, No Fire – 13

Severe Weather & Natural Disaster – 2

Severe Weather or Natural Disaster, Other – 1
Lightning Strike, No Fire – 1

Special Incident Type – 1

Citizen Complaint – 1

TOTAL – 880

FIRE DEPARTMENT RESPONSE BY DISTRICT (Alarms in the Borough):

Greenville West Side 9610 – 171
Greenville North Side 9620 – 112
Greenville Downtown and Southside 9630 – 264
Greenville East Side 9640 – 255

MUTUAL AID RESPONSE TO:

Fallowfield (Station 13) – 1

North Shenango (Station 17) – 1
West Salem (Station 73) – 22
Transfer (Station 75) – 4
Sheakleyville (Station 81) – 5
Jamestown (Station 89) – 21
Hempfield (Station 94) – 24

TOTAL – 880

FIRE CALLS BY TIME OF DAY:

0000-0800 hrs. – 172
0800-1600 hrs. – 364
1600-2400 hrs. – 344

TOTAL – 880

FIRE CALLS BY DAY OF WEEK:

Monday – 116
Tuesday – 138
Wednesday – 118
Thursday – 133
Friday – 113
Saturday – 139
Sunday – 123

TOTAL – 880

BUREAU OF FIRE PREVENTION:

Witnesses Emergency Evacuation Drills – 3

Greenville High School – 2
St. Mike's School – 1

New Fire Alarm System Test, Acceptance – 1

American Scholar Community Square – 1

Issue Fireworks Permit, Public Display – 1

Packard Ballfield – 1

Figure Occupant Load – 3

Thiel Food Center – 1
The Ark Café – 1
Bissells Alley Cat – 1

Inspections – 330

Annual Inspections (Non-Permitted Building) – 137
Bi-Annual Inspections (Non-Permitted Building) – 44

Semi-Annual Inspection (Non-Permitted Building) – 1
Re-Inspections – 104
Annual Inspections (Permitted) – 44

2015 FIRE DEPARTMENT PERSONNEL

Full Time Personnel:

Lt. Steve Thompson
Lt. Richard Craig
Lt. Michael Cadman
FF Brian Albaugh


Part Time Personnel:

FF Michael White
FF Ronald Graham
FF Cody Mowris
FF Brian Morrow
FF Jeffrey Savchuk, Jr.
FF Michael McConnell


Volunteer Fire Fighter:

Michael Curtician
Nels Fricke

2015 Incident Type - Fire

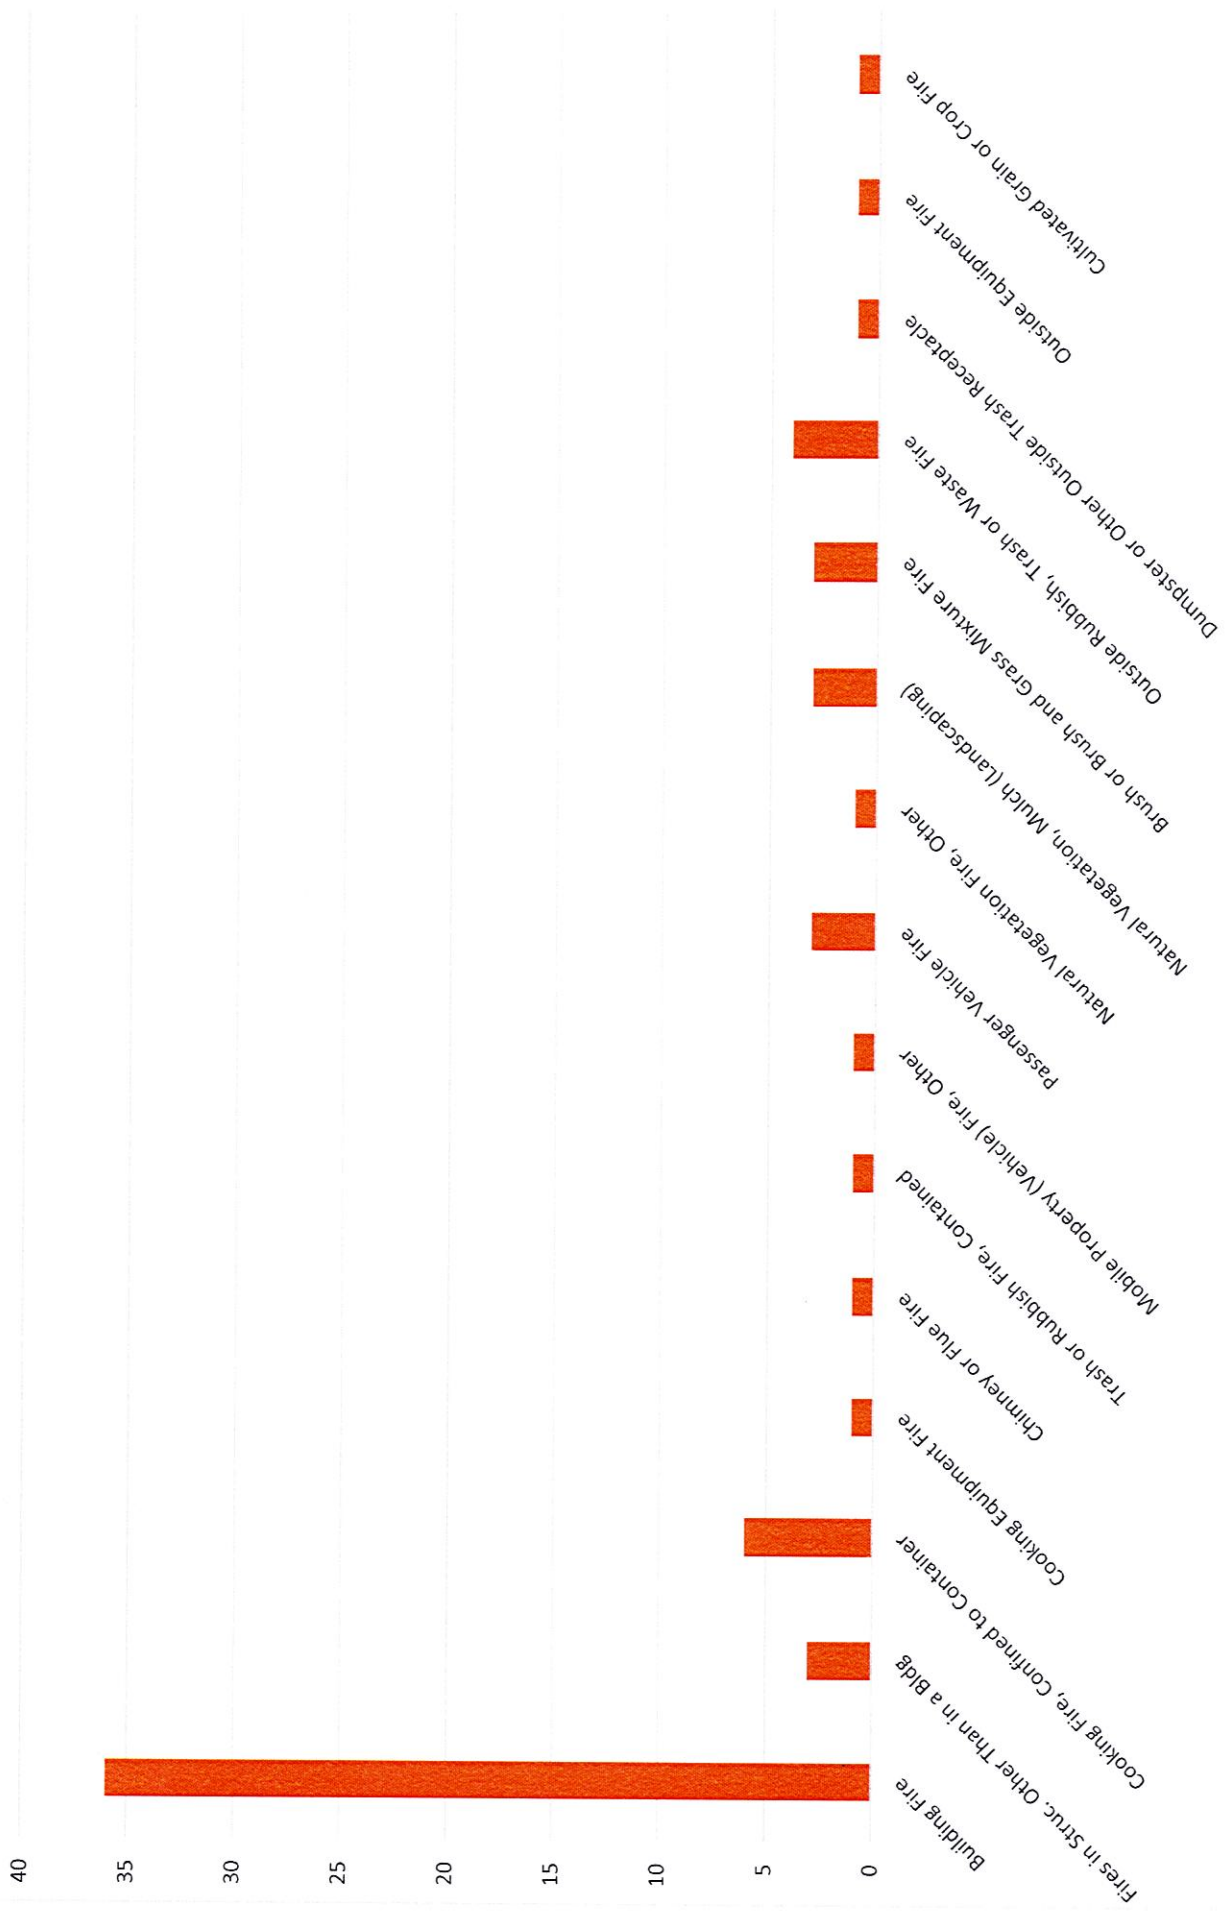


2015 Incident Type - Overpressure Rupture, Explosion, Overheat (No Fire) & Rescue and Emergency Medical Service Incident

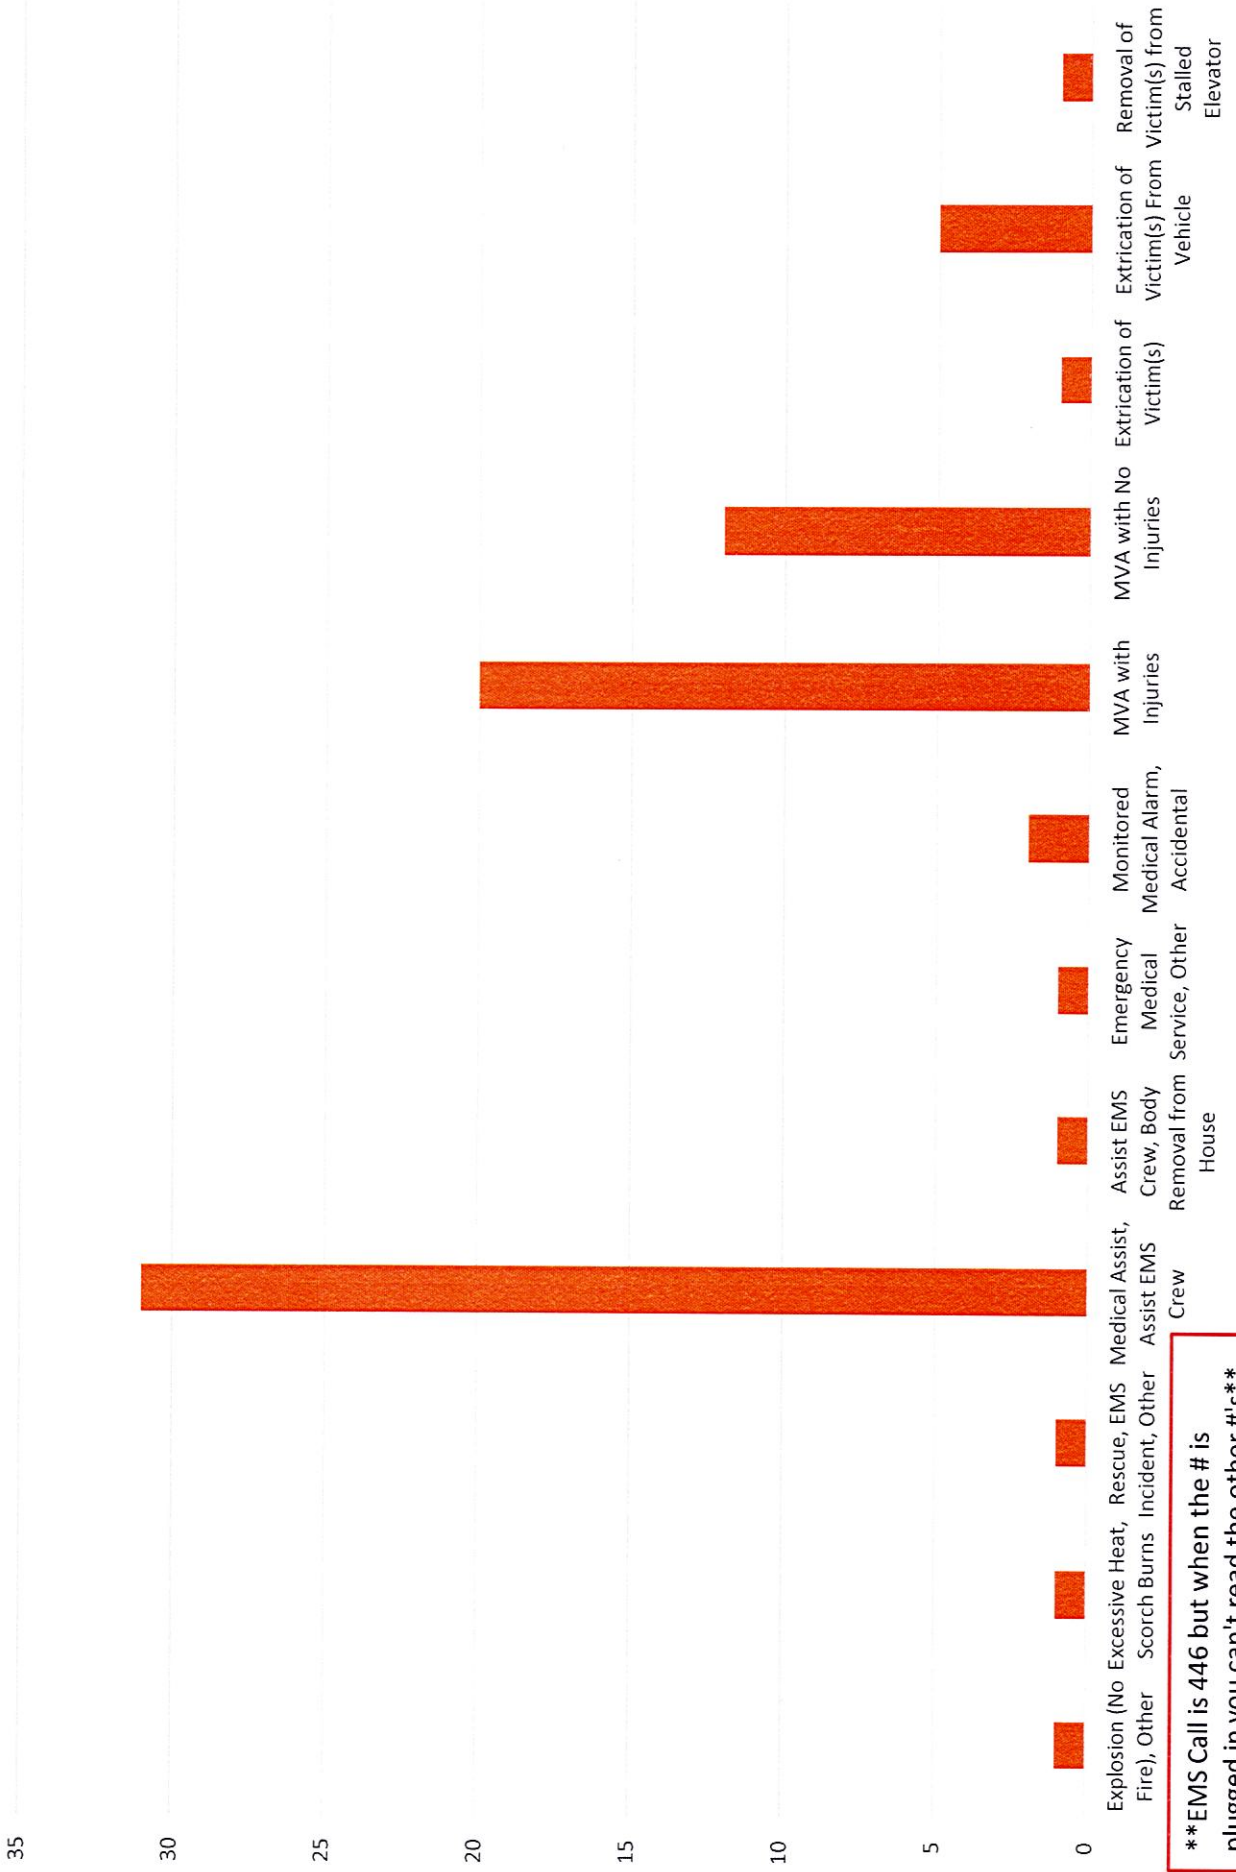


****EMS Call is 446 but when the # is plugged in you can't read the other #'s.****


2015 Incident Type - Hazardous Condition (No Fire)

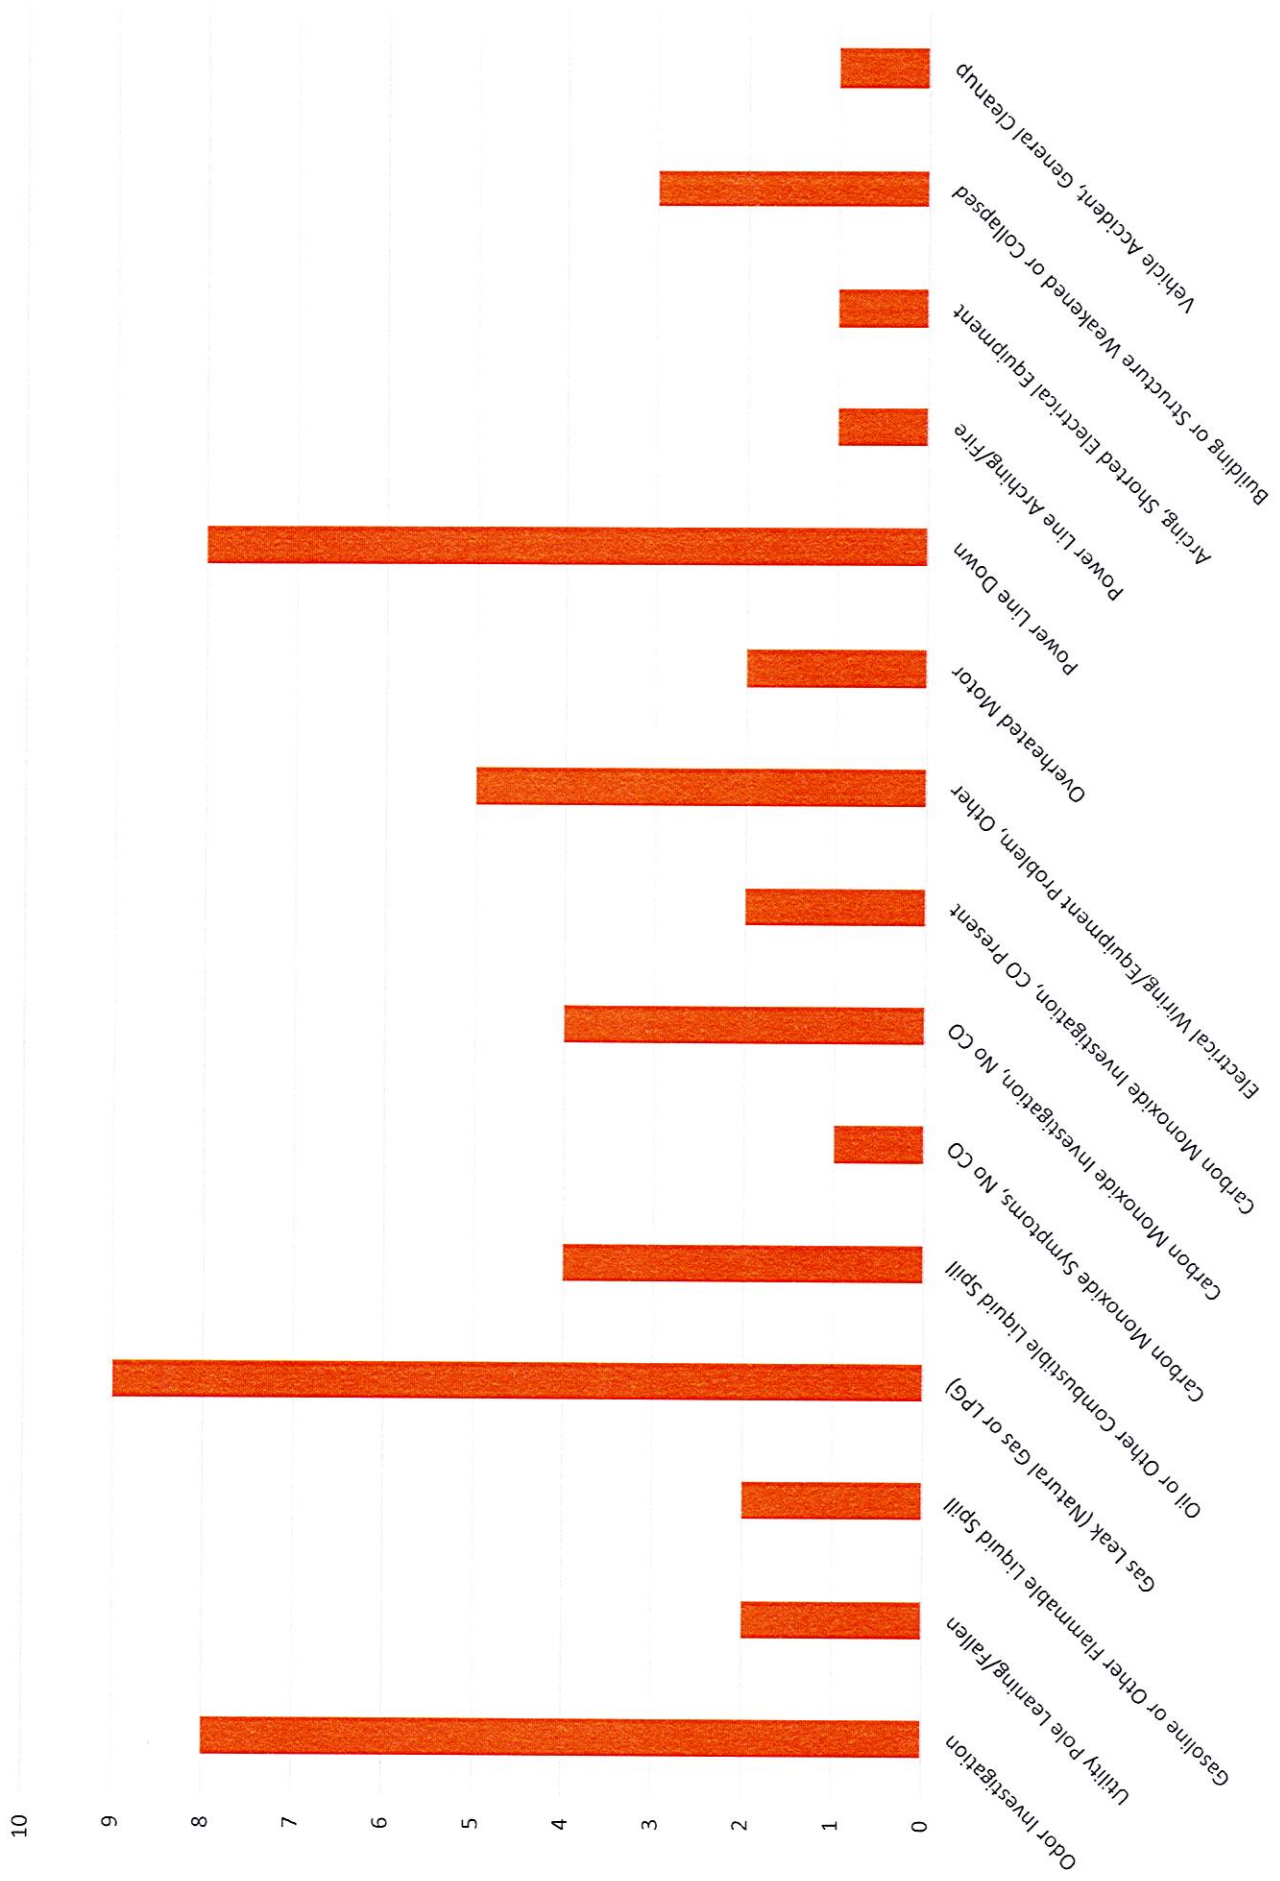


2015 Incident Type - Service Call, Part 1

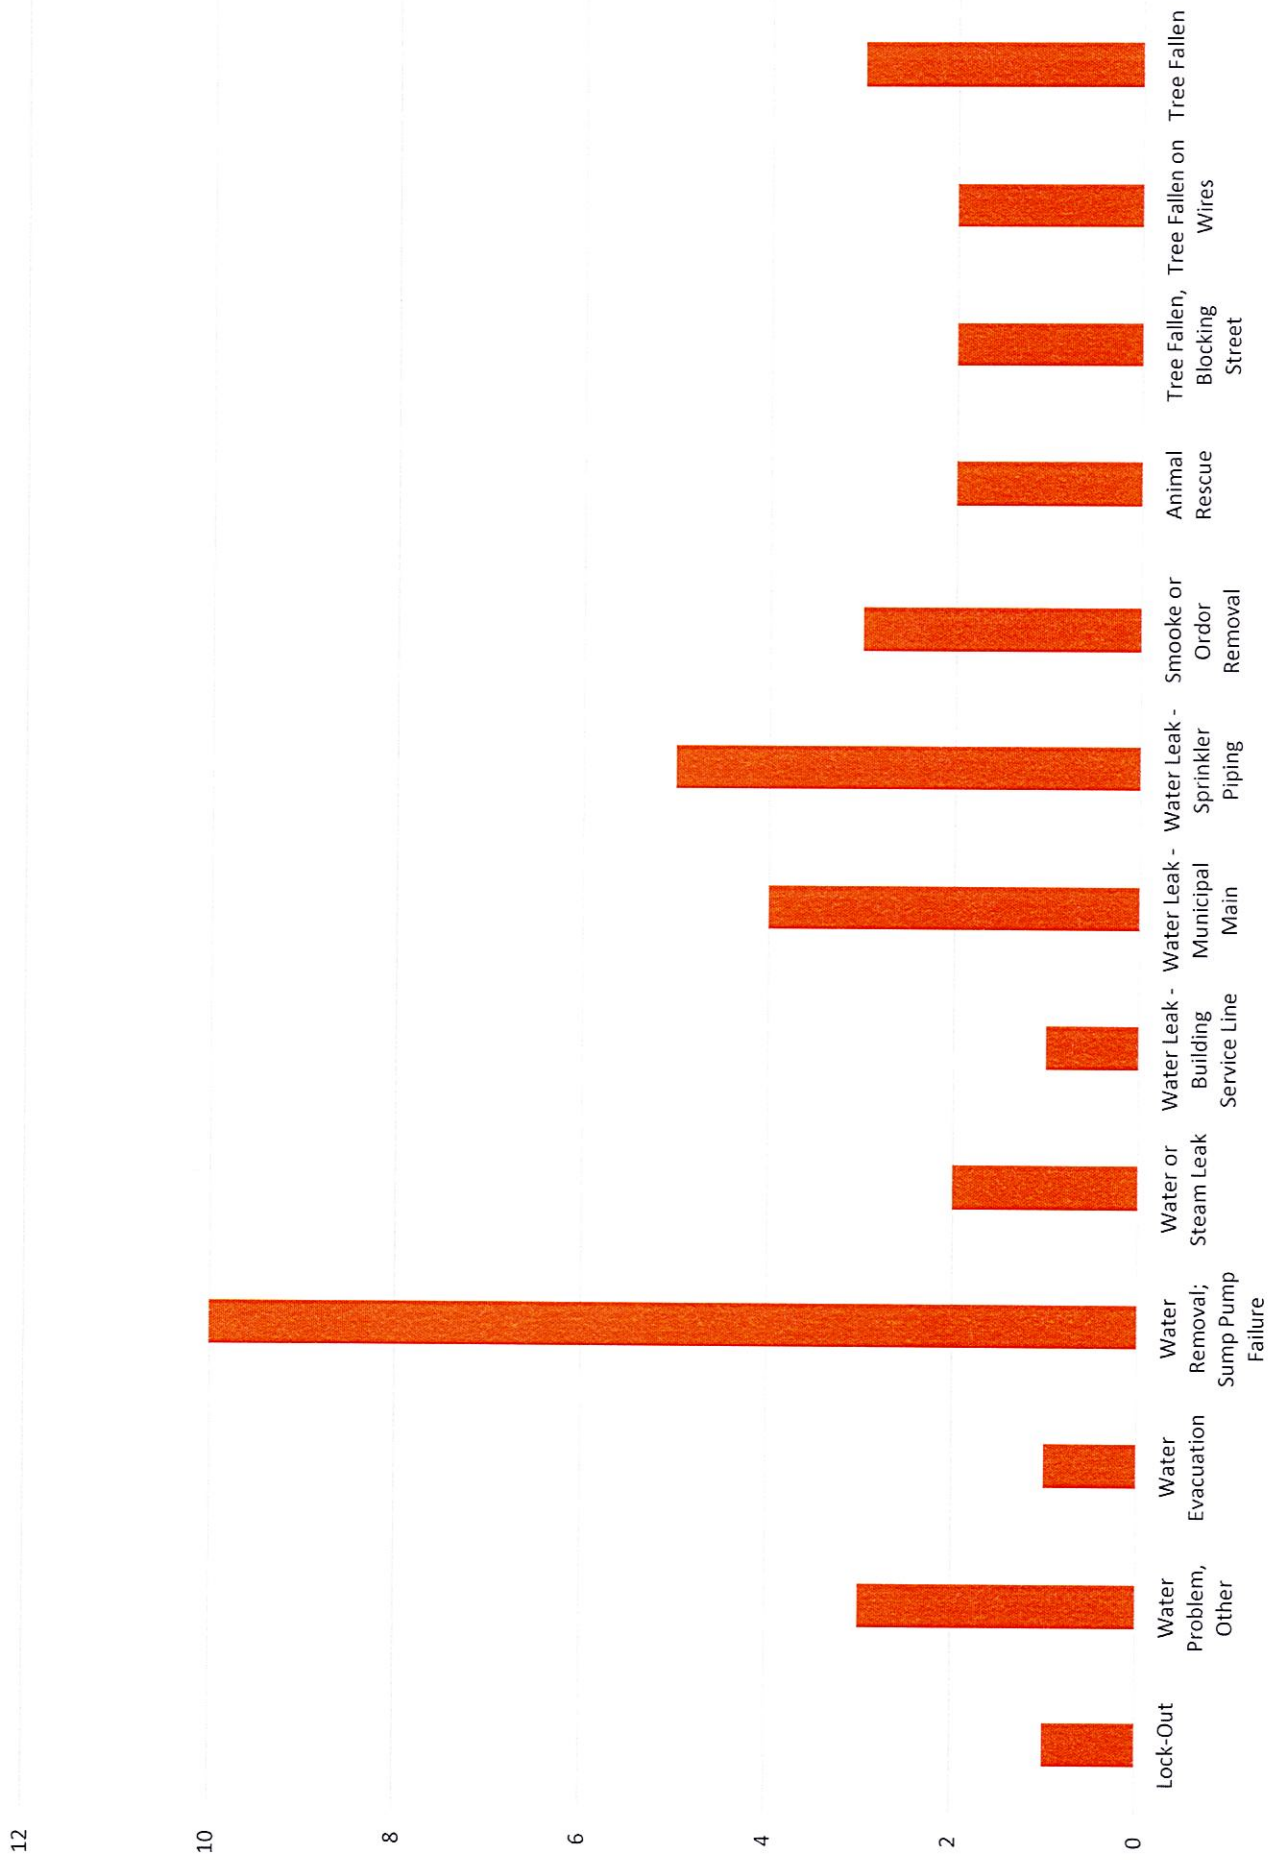


2015 Incident Type - Service Call, Part 2

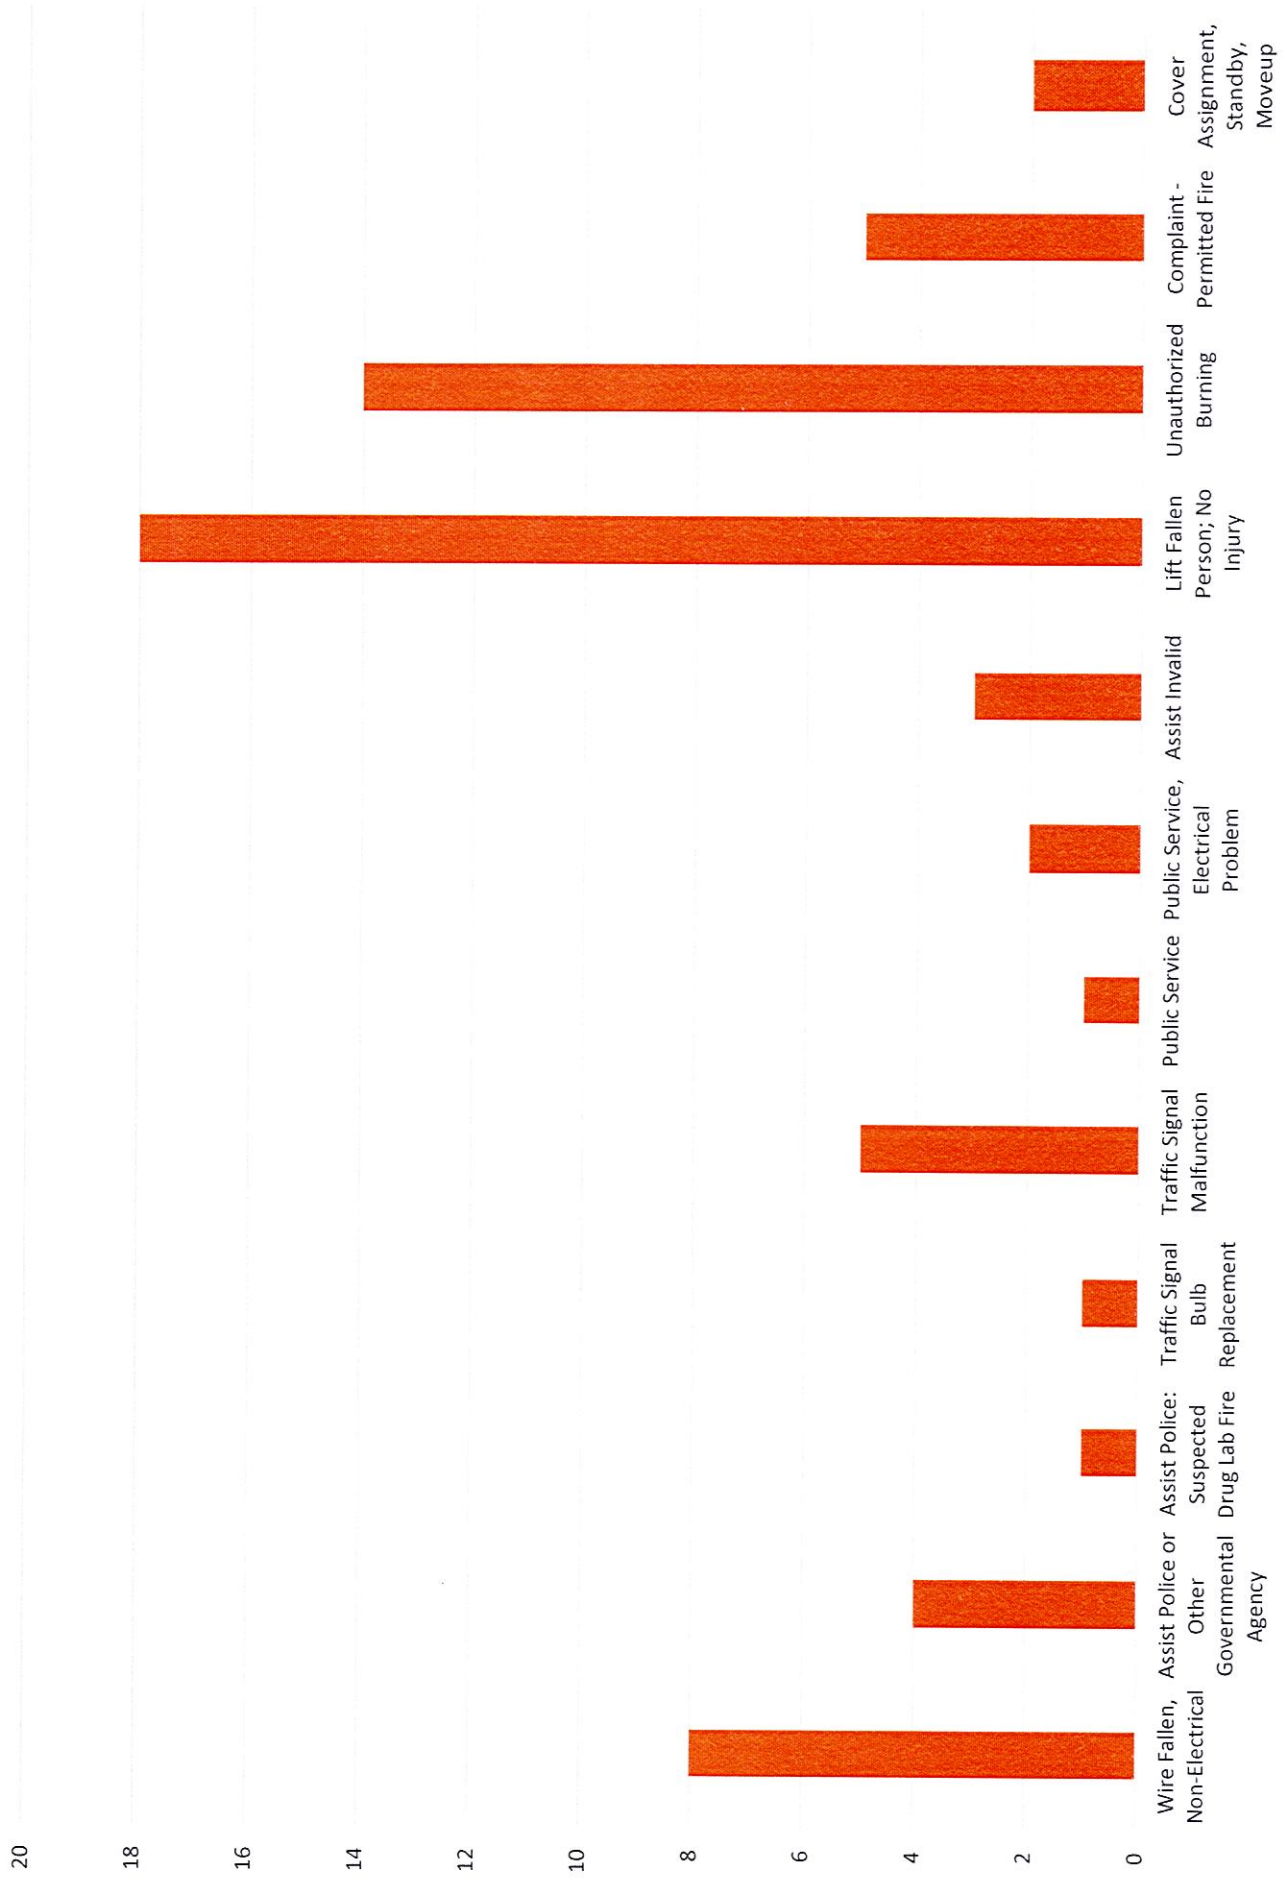


2015 Incident Type - Good Intent Call

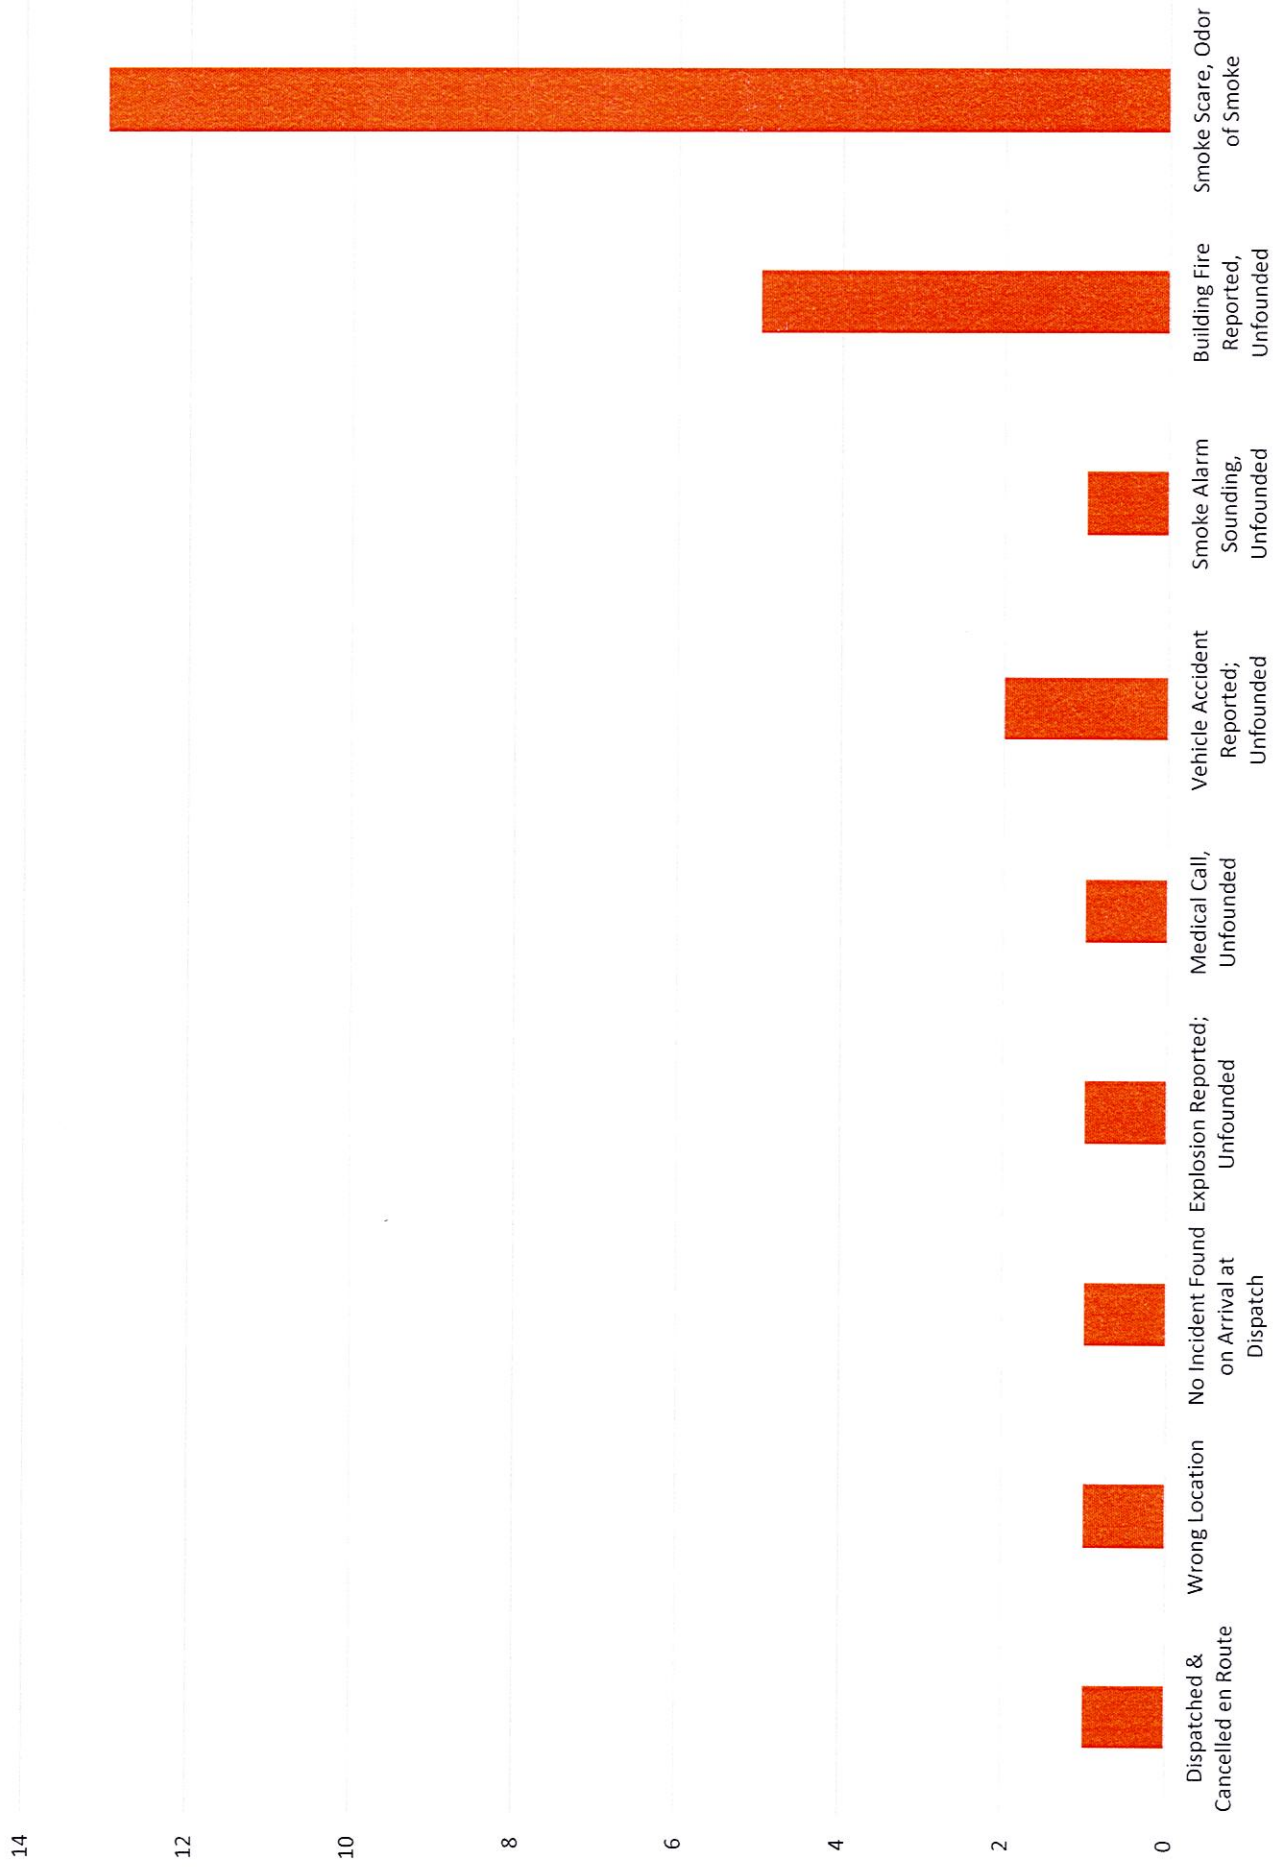


2015 Incident Type - False Alarm & False Call

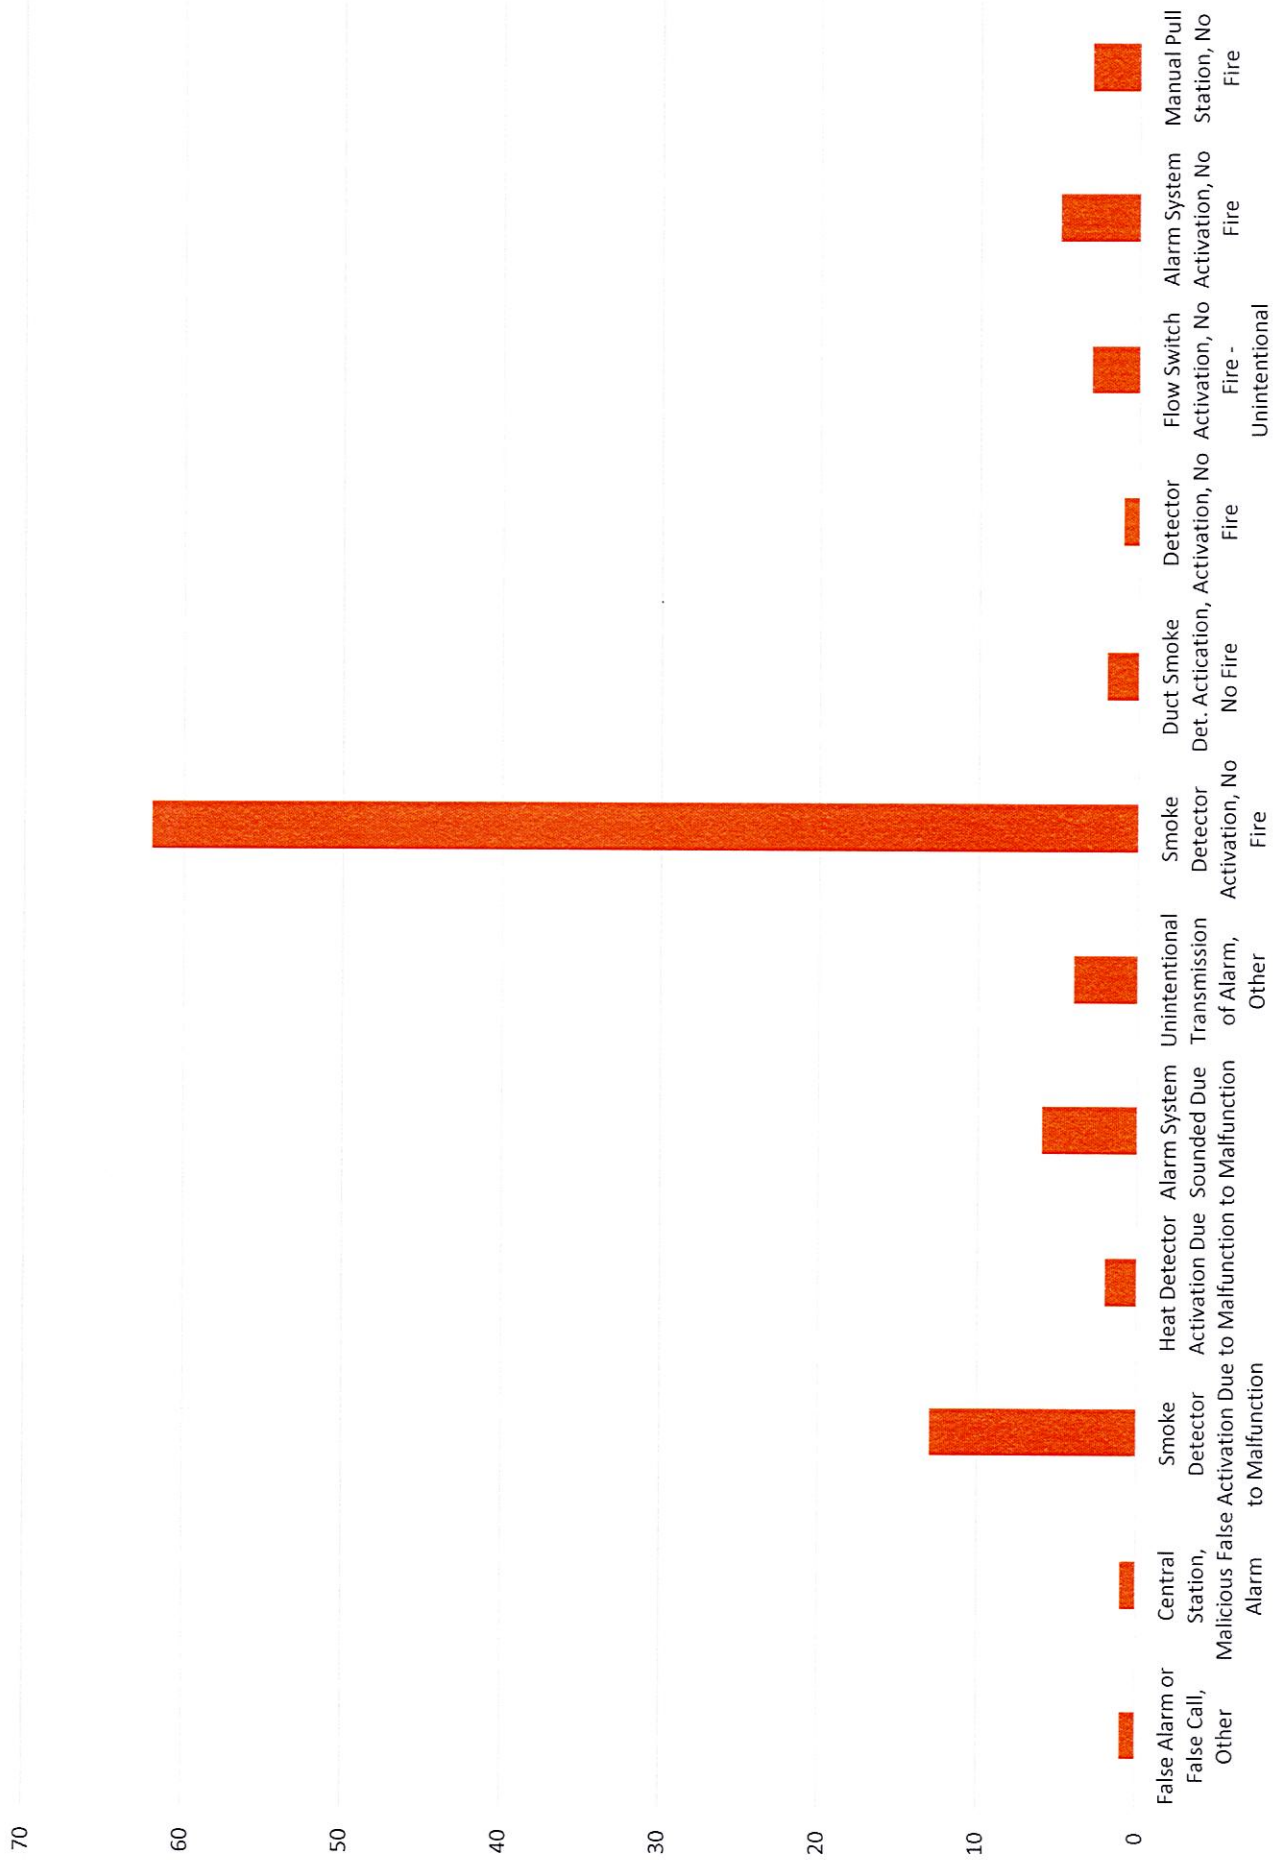

2015 Incident Type - Severe Weather & Natural Disaster & Special Incident Type

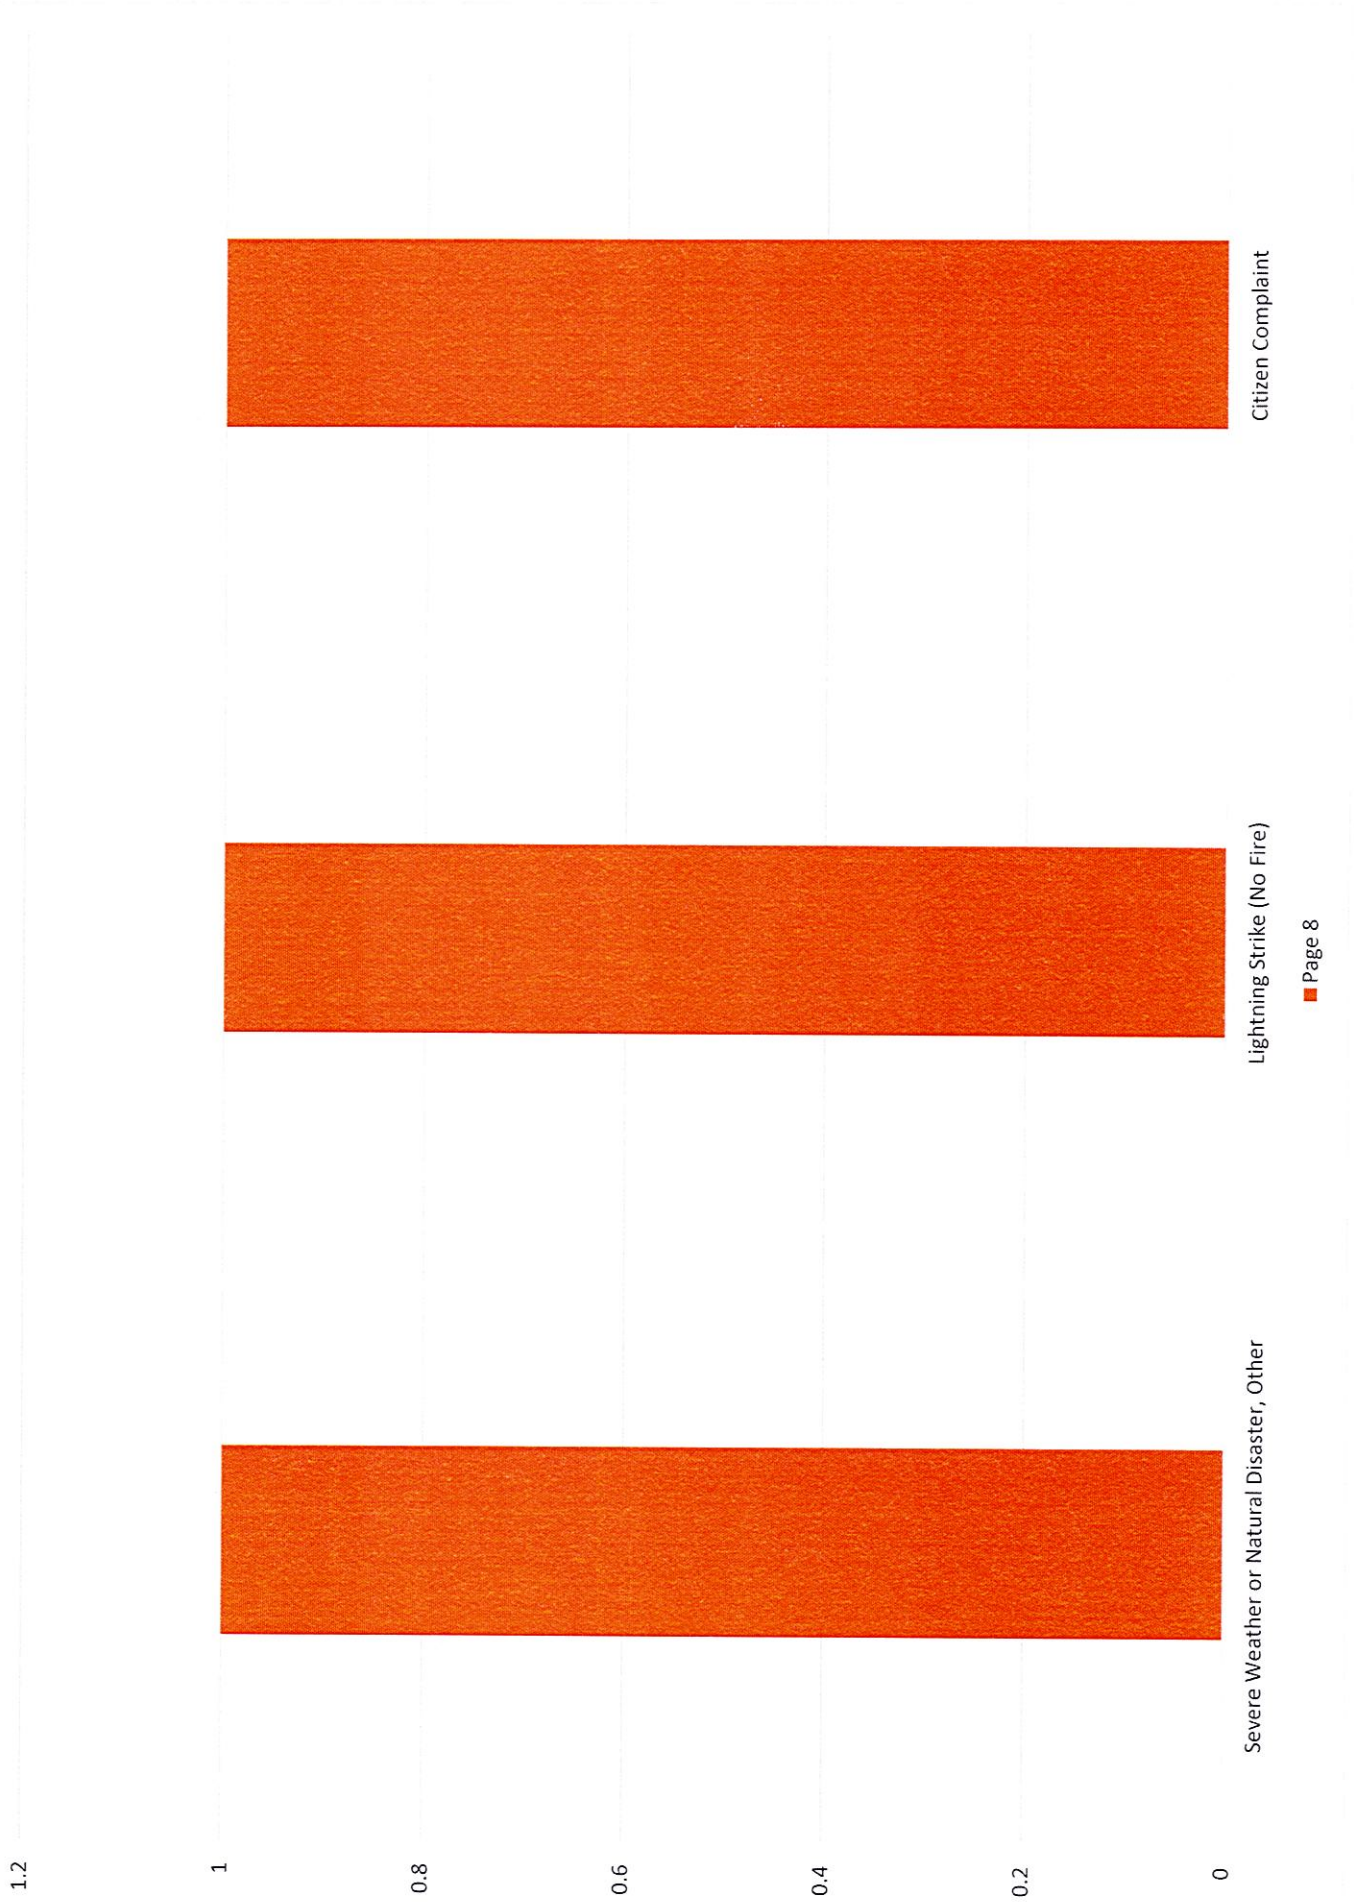

2015 Mutual Aid Responses

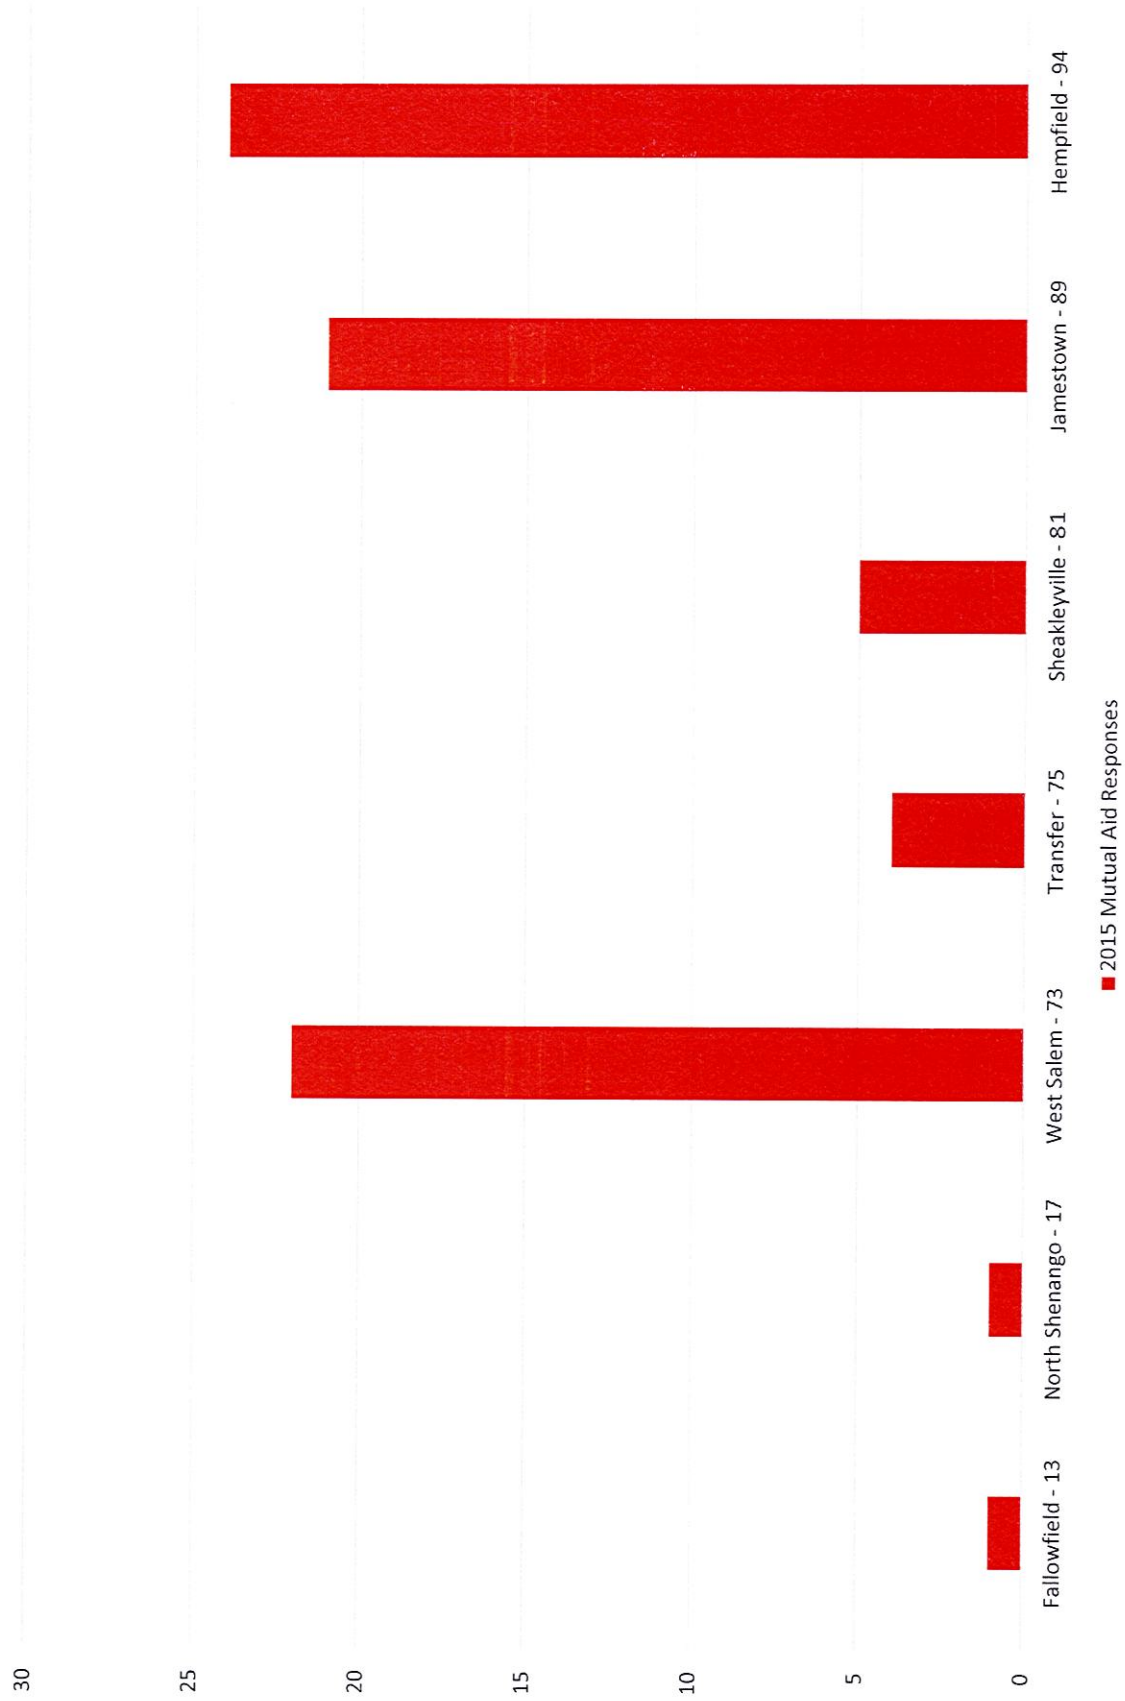

2015 Borough Alarms

